

Vapor Tight Installation Instruction

Read the Instruction carefully to ensure proper installation.
Please keep this instruction for future use.

⚠ WARNING

To avoid the risk of fire and electric shock, this product should be installed, inspected, and maintained by a qualified electrician only. Installation should be completed by an individual familiar with the construction and operation of the luminaire. Installation must be following nation and local building and electrical codes.

Safety Warning:

To avoid electric shock:
Be certain electrical power is OFF before and during installation and maintenance.
The luminaire must be supplied by a wiring system with an equipment grounding conductor.
To avoid burning hands:
Make sure the lenses are cool when performing maintenance.
To avoid product degradation:
Make sure the wire supply voltage is compatible with the luminaire supply.
Use proper supply wiring as specified on the luminaire nameplate.
Avoid usage in environments containing sulfur, chlorine, other halides, methyl acetate, ethyl acetate, cyanoacrylates, glycol ethers, formaldehyde, or butadiene.


Notes:

Instructions do not cover all details and all possible product configurations.
Do not restrict luminaire ventilation.
Ensure LED luminaire is not covered with materials that will prevent convection or conduction cooling.
Ensure LED luminaire has the correct polarity before installation.
Avoid exposing wiring to metal edges and sharp objects.


Maintenance:

Perform visual, electrical, and mechanical inspections regularly. It is recommended that checks be made at least once a year. Electrically check to make sure that all connections are clean and tight. Mechanically check that all parts are properly assembled.


Line Drawing

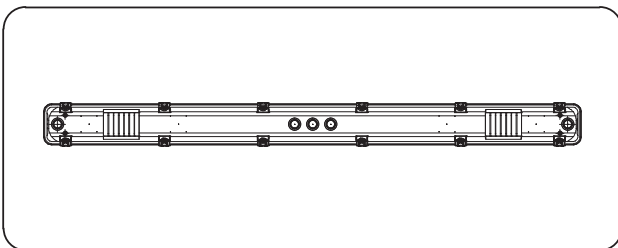


Installation

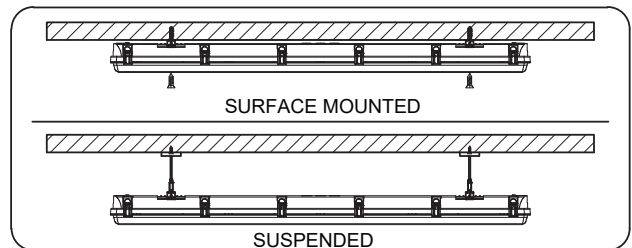

Disassembly ① -- ②

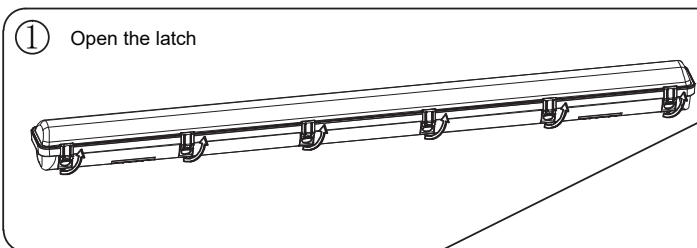

Assembly ② -- ①

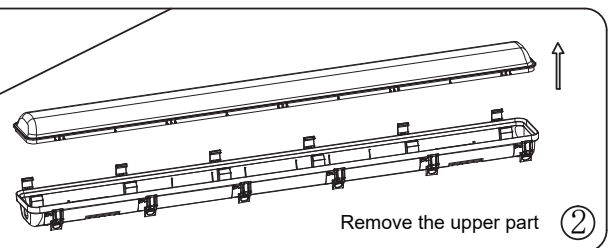

Wiring Diagram

